


SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to SS-EN ISO 354 and SS 25269 (proposal)

CLIENT: Offecct AB
 OBJECT: Soundwave Flo with Basfill, 1 group consisting of 3 x 2 panels (each panel is 585 x 585 x 51 mm), (2 groups were measured, total area tested 4.10 m²)

1/3 octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)	
	1/3 octave band	Octave band
50	0.05	
63	0.09	0.1
80	0.19	
100	0.22	
125	0.34	0.4
160	0.68	
200	0.74	
250	1.22	1.2
315	1.71	
400	2.00	
500	2.29	2.3
630	2.54	
800	2.58	
1000	2.57	2.5
1250	2.50	
1600	2.44	
2000	2.38	2.4
2500	2.32	
3150	2.24	
4000	2.15	2.3
5000	2.46	

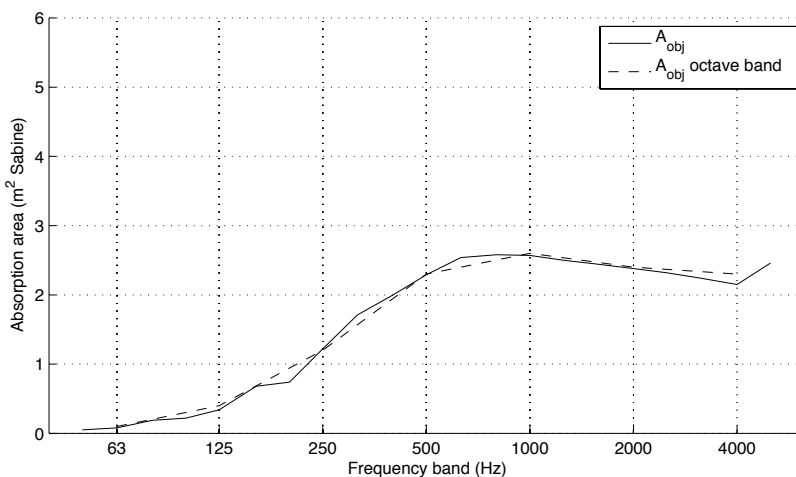

CONDITIONS

Date of test: 2013-06-17 Object area: 4.10 m² Relative humidity: 77%
 Date: 2013-09-03 Reverberation room volume: 200 m³ Temperature: 14°C

Test report: 13-99-R1 (Akustikverkstan Sweden)
 Signature: Pontus Thorsson